

1-Wire driver for the REXYGEN system
(the OwsDrv module)

User guide

REX Controls s.r.o.

Version 3.0
Plzeň (Pilsen), Czech Republic
2023-12-15

Contents

1	The OwsDrv driver and the REXYGEN system	2
1.1	Introduction	2
1.2	System requirements	2
1.3	Installation of the driver on the host computer	2
1.4	Installation of the driver on the target device	3
1.4.1	Running the 1Wire server	3
2	Including the driver in the project	5
2.1	Adding the OwsDrv driver	5
2.2	Connecting the signals in the algorithm	5
3	Driver configuration	9
3.1	Configuration dialog	9
3.2	Use of alarms of the owfs program	11
3.3	Special signals	14
4	Troubleshooting	17
	Bibliography	18

Chapter 1

The OwsDrv driver and the REXYGEN system

1.1 Introduction

This manual describes the `OwsDrv` driver for data exchange between the REXYGEN system and various devices supporting the 1-Wire protocol [1]. The `OwsDrv` driver relies on the `OWFS` 1-Wire File System [2], namely the `owserver` module.

It is possible to communicate with any device supported by the `OWFS`.

1.2 System requirements

In order to use the driver, the host computer (development) and the target computer (runtime) must have the following software installed:

Host computer

Operating system	one of the following: Windows 10/11, GNU/Linux
Development tools	version of the REXYGEN system development tools for corresponding operating system

Target device

REXYGEN system	runtime core for GNU/Linux
IO driver	version for GNU/Linux
OWFS	version for GNU/Linux

1.3 Installation of the driver on the host computer

The `OwsDrv` driver is included in the installation package of the Development tools of the REXYGEN system. It is necessary to select the corresponding package in the installer. The REXYGEN system typically installs to the `C:\Program Files\REX Controls\REX <version>` folder.

The following files are copied to the installation folder:

Bin\OwsDrv_H.dll – Configuration part of the OwsDrv driver.

Doc\PDF\ENGLISH\OwsDrv_ENG.pdf – This user manual.

1.4 Installation of the driver on the target device

If there is no RexCore runtime module installed on your target device, install it first using the Getting started guide of the REXYGEN system [3]. The installation encompasses all essential drivers, including OwsDrv.

If you wish to install OwsDrv separately, you can do so from the command line using the following command:

```
sudo apt-get install rex-owsdrv
```

In order to communicate with the 1-Wire devices from the REXYGEN system it is necessary to install the `owserver` and `ow-shell` packages of the OWFS suite, which is done by the following command:

```
sudo apt-get install owserver ow-shell
```

1.4.1 Running the 1Wire server

The `owserver` must be configured to use the 1-Wire bus master of your choice. Use `sudo nano /etc/owfs.conf` command to edit the file.

E.g. for use with USB to 1-Wire adapter (e.g. DS9490R):

```
!server: server = localhost:4304
allow_other
server: port = localhost:4304
server: usb = all
timeout_volatile = 2
```

For I2C devices based on the DS2482-100 or DS2482-800 chip the `/etc/owfs.conf` file should contain the following:

```
!server: server = localhost:4304
allow_other
server: port = localhost:4304
server: i2c=ALL:ALL
timeout_volatile = 2
```

It is also necessary to activate the I2C bus and enable the `i2c-dev` kernel module. If you have used our installation scripts for your platform, everything is ready for you. If you have not, you probably know what to and how to do it. In any case, just check that e.g. `/dev/i2c-1` is present.

For 1-Wire bus over Raspberry Pi GPIO use following `owfs.conf` file:

```
!server: server = localhost:4304
allow_other
server: port = localhost:4304
server: w1
timeout_volatile = 2
```

It is also necessary to activate the I2C and 1-Wire GPIO bus (`sudo raspi-config -> Enable both I2C and 1-Wire`).

Restart the `owservice` and list the detected 1-Wire devices by the `owdir /uncached` command. The output should look like this:

```
/28.551DDF030000
/bus.1
/bus.0
/uncached
/settings
/system
/statistics
/structure
/simultaneous
/alarm
```

The first line is the 1-Wire device ID (the DS18B20 temperature sensor in this case).

Read the temperature by issuing the command:

```
owread /28.551DDF030000/temperature12
```

(change the ID to match your device).

Chapter 2

Including the driver in the project

The driver is included in the project as soon as the driver is added to the project main file and the inputs and outputs are connected in the control algorithms.

2.1 Adding the `OwsDrv` driver

The project main file with the `OwsDrv` driver included is shown in Figure 2.1. There is one block which must be added to the project to include the driver. A block of type `IODRV` renamed to `OWS` and connected to the `Drivers` output of the main `EXEC` block. The name of this block (`OWS`, see Fig. 2.1), is the prefix of all input and output signals provided by this driver. The three most important parameters are:

- `module` – Name of the module linked to the driver, in this case `OwsDrv`. The name is CASE SENSITIVE!
- `classname` – Class of the driver, in this case `OwsDrv`. The name is CASE SENSITIVE!
- `cfgname` – Name of the driver configuration file (`*.rio`, REXYGEN Input/Output). It is a simple text file which is automatically created when necessary. It can have arbitrary name (here `ow_cfg.rio`). The configuration is further discussed in chapter 3.

The name of this block (`OWS`, see Fig. 2.1), is the prefix of all input and output signals provided by this driver.

The above mentioned parameters of the `IODRV` function block are configured in REXYGEN Studioprogram. The configuration dialog is shown also in Fig. 2.1.

2.2 Connecting the signals in the algorithm

The input and output signals of the driver must be interconnected with the individual tasks (`.mdl` files). The individual tasks (`QTASK` or `TASK` blocks) are connected to the `QTask`, `Level0`, . . . , `Level13` outputs of the main `EXEC` block.

The inputs and outputs of the `OwsDrv` driver can be accessed as shown in Fig. 2.2.

The `From` block allowing the user to read one input signal has the `Goto tag` set to `OWS__temperature`. The `Goto` block allowing the user to set one output signal would have the `Goto tag` set to `OWS__name`. The blocks always have the `OWS` prefix right at the beginning of the tag followed by two `_` characters (underscore).

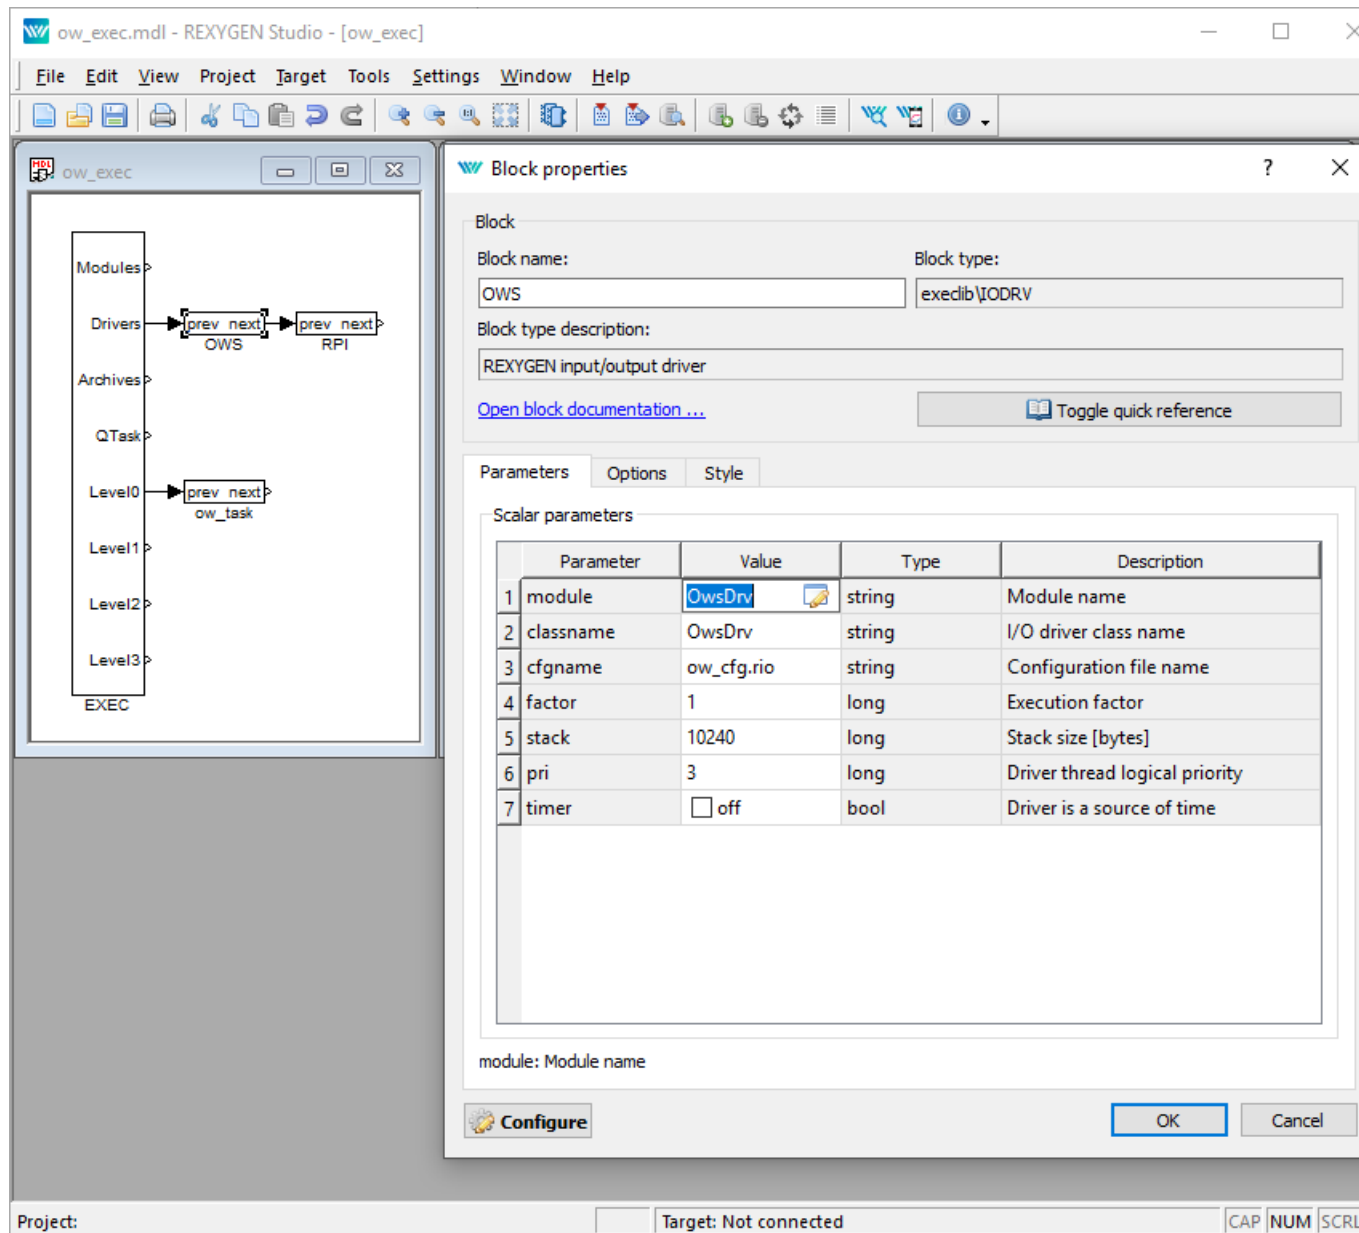


Figure 2.1: An example of project main file with the OwsDrv driver included

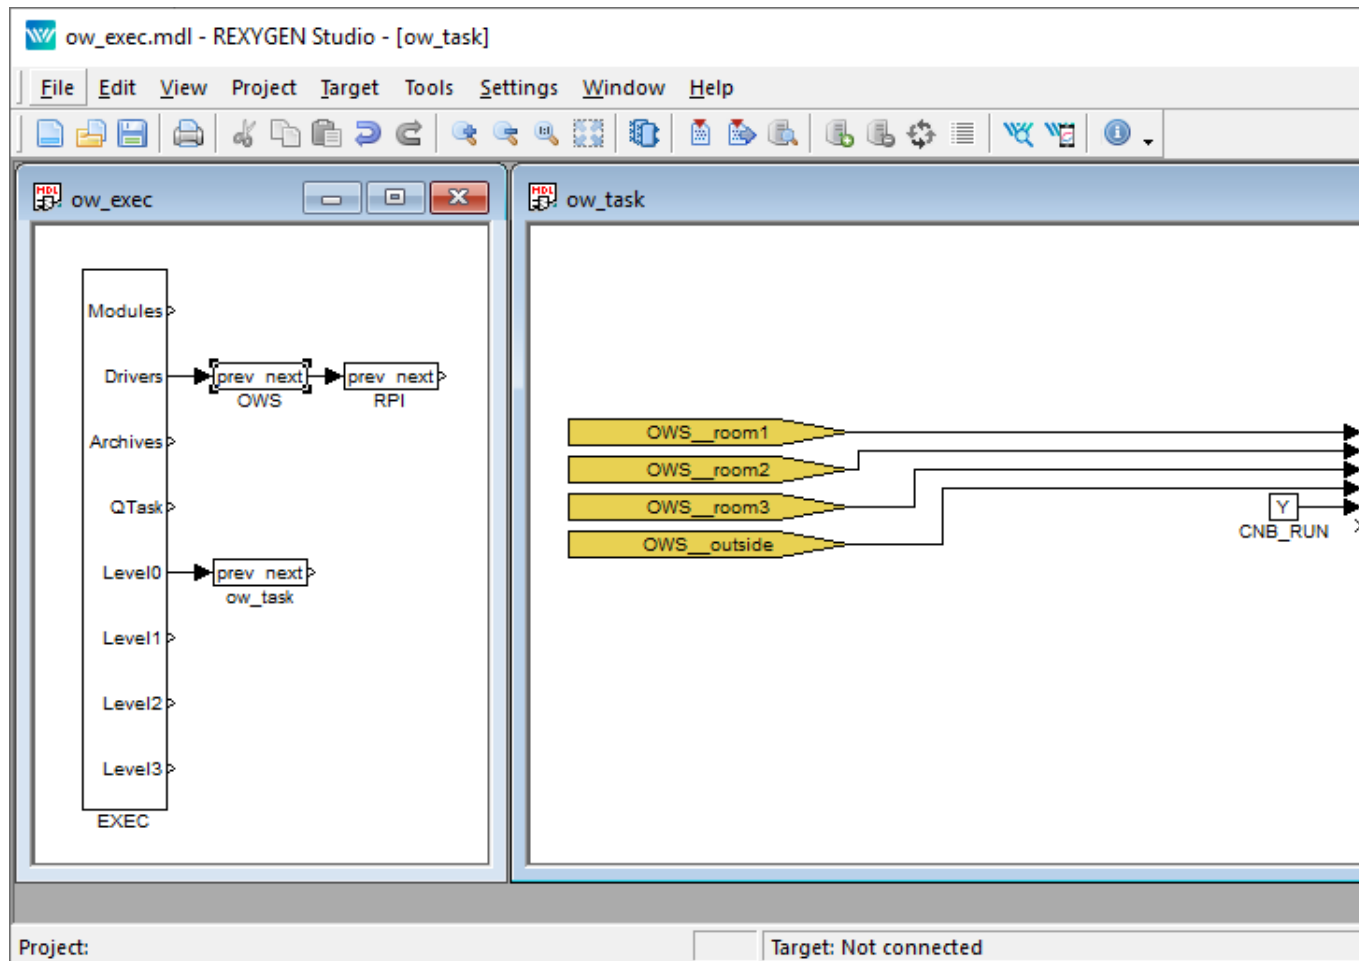


Figure 2.2: Temperature logging based on the `OwsDrv` driver

Chapter 3

Driver configuration

This chapter describes the configuration of individual input and output signals and their symbolic naming. The signals are mapped to individual variables of the OWFS server.

3.1 Configuration dialog

The configuration dialog shown in Fig. 3.1 is part of the `OwsDrv_H.dll` file. It can be activated from REXYGEN Studio by pressing the **Configure** button in the parameters dialog of the `IODRV` block (see chapter 2).

The upper part of the dialog defines the connection to the `owserver`. The `owserver` typically runs on the same machine as `RexCore` but it is not a rule.

The individual signals to read or write from the REXYGEN control algorithm are defined in the lower part of the configuration dialog. Simply add the signals, use the device IDs displayed by the `owdir` command.

For an output signal (in the I/O column the `output` is selected), the `Value` is once written to the output if it is not overwritten from the control algorithm.

The signal table in the driver configuration dialog is processed cyclically during the run-time in the following way. Each output signal which has been changed since the last write is written with the value. Similarly, all input signals are being cyclically read in the same order. When a large number of inputs is configured the reading of the whole table can take quite a long time. Therefore, the `owserver` program allows to indicate signal changes as so called alarms in the `/alarm` directory, see section 3.2. This driver is able to process alarms from REXYGEN version 2.5.

Moreover, if the `Uncached` option is checked then the given signal will be always read directly from the connected integrated circuit (e.g. from the thermometer). If the `Uncached` is not checked then the returned value will be read from the cache memory which is typically updated each 15 seconds. Note: The more signals has chosen `Uncached`, the slower the response of this driver.

To optimize the performance of this driver it is helpful to know how the driver operates internally. The main loop activated each period of the driver always handles no more than one request to the `owserver` program and after sending a request to `owserver`,

OwsDrv configuration

Target computer name/IP address:

Maximum number of consecutively served alarms:

Maximum number of retries after item error:

Timeout for pending operations (in seconds):

	REX I/O Name	Sensor/Actuator Path	Type	I/O	Init. Value	Readable	Writable
1	room1	/28.551DDF030000/temperature12	double	input	22	<input checked="" type="checkbox"/> true	<input type="checkbox"/> false
2	room2	/28.063BC8040000/temperature12	double	input	22	<input checked="" type="checkbox"/> true	<input type="checkbox"/> false
3	room3	/28.B8BDBC020000/temperature12	double	input	22	<input checked="" type="checkbox"/> true	<input type="checkbox"/> false
4	outside	/28.3F11C8040000/temperature12	double	input	10	<input checked="" type="checkbox"/> true	<input type="checkbox"/> false

Figure 3.1: Configuration dialog of the 1-Wire driver

it does not wait on an immediate response (ie. If the response data are not available, it tries to get them in the next loop run). After initializing the driver (when the real/time executive is running) the main loop operates as follows:

- It check whether the currently processed request (from the previous call of this loop) has been completed.
- If so, it starts to process alarms (for details see next section).
- If no alarm is processed, it tries to write a single output value from the control algorithm.
- If no write is processed, it tries to read one input value to the control algorithm.

The above procedure shows that the highest importance (priority) has alarm processing, then writing the output values from the algorithm, and the lowest reading signals. In frequent occurrence of alarms (which is not normal) it could happen that writing and reading requests are not served at all (this effect is also called starvation). Therefore, it is possible to set the maximum number of consecutive served alarms in the driver configuration in Fig. 3.1. After this number of served alarms, the first of the other pending requests (writing or reading items) is processed.

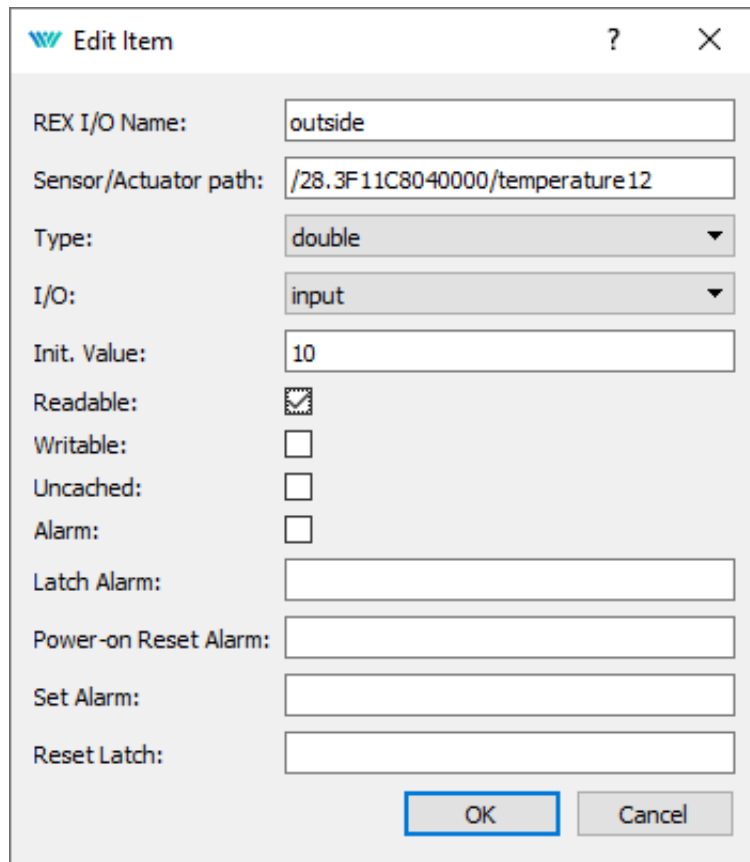


Figure 3.2: Item configuration dialog of the 1-Wire driver

3.2 Use of alarms of the owfs program

Work with alarms belongs among the advanced techniques and requires good knowledge of `owfs` and the `owserver`. It is recommended to use alarms only when the 1-Wire driver response is too slow.

Configuration of one alarm in the case of DS2408 circuit based 1-Wire device is shown in Fig. 3.3. The path to the signal (`Sensor/Actuator path`) is entered without starting directory `/alarm`. After selecting the `Alarm`, additional strings should be entered. The configured string values are preprocessed and stored to working string variables for each alarm (before start of the driver):

`sPath` – path to the device, here: `/29.066418000000`. For reading or writing values, the `/alarm` directory can be inserted before this path, and the character `/` and the value of some of the preprocessed strings (see next items) can be appended after this path

`sSensed` – file with the value to be read, here: `sensed.BYTE`

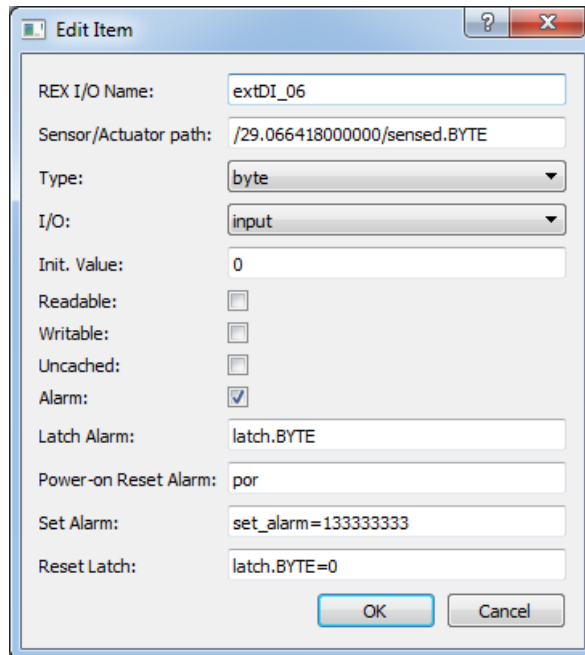


Figure 3.3: Example of configuration dialog for an alarm

`sLatch` – file with the sensed value change flag(s), here: `latch.BYTE`

`sAlarmPor` – file indicating the power-on reset of the device, here: `por`

`sSet` – file, to which should be written the configuration of next alarm generation (first part of the `Set Alarm` item to the character =), here: `set_alarm`

`sSetVal` – value, which should be written to the `sSet` file (second part of the `Set Alarm` item from the character =), here: `133333333`

`sLatchRes` – file, to which should be written the value indicating that the alarm has been served (first part of the `Reset Latch` item to the character =), here: `latch.BYTE`

`sLatchResVal` – value, which should be written to the `sLatchRes` file (second part of the `Reset Latch` item from the character =), here: `0`

The `OwsDrv` uses a state machine with the following states for the alarm processing:

`NOT_USED` – The driver configuration does not contain any alarm.

`INIT` – The initial state of the state machine.

`ALARM_DIR` – Browsing the `/alarm` directory contents.

ALARM_PROCESS – Start of each alarm processing.

ALARM_POR_READ – Detecting whether the device did not perform the power-on reset initialization by reading a file whose name is stored in the **sAlarmPor** string.

ALARM_POR_READ_WAIT – Waiting for the completion of the reading started in the **ALARM_POR_READ** state.

ALARM_SET – Setting the alarm generated on the device after power-on reset. The string value in **sSetVal** is written into the file whose name is specified by the **sSet** string.

ALARM_SET_WAIT – Waiting for the completion of the writing started in the **ALARM_SET** state. After that, all outputs are checked. When an output whose path starts with the **sPath** string is found, the initial value specified in the **Init. Value** item is written to the corresponding file (see fig. 3.3).

ALARM_INIT_WRITE_WAIT – Waiting for the completion of each individual initial value writing started in the previous state.

ALARM_POR_RESET – Clearing of the power-on reset initialization flag. The value 0 is written into the file whose name is specified by the **sAlarmPor** string.

ALARM_POR_RESET_WAIT – Waiting for the completion of the power-on reset flag clearing.

ALARM_LATCH – Determining whether the device indicates the occurrence of an alarm. In this state, the file whose name is specified by the **sLatch** string is read. If the content is non-zero, or the list of items contains at least one non-zero, the occurrence of alarm since the last reading is detected.

ALARM_LATCH_WAIT – Waiting for the completion of the reading started in the **ALARM_LATCH** state.

ALARM_SENSED – Reading the signal after the alarm occurred. If the alarm occurrence has been detected in the **ALARM_LATCH** state, reading of the file whose name is specified by the **sSensed** string in the **/alarm** directory is started.

ALARM_SENSED_WAIT – Waiting for the completion of the reading started in the **ALARM_SENSED** state.

ALARM_LATCH_RESET – Clearing of the alarm occurrence flag. The string value in **sLatchResVal** is written into the file whose name is specified by string **sLatchRes** in the **/alarm** directory.

ALARM_LATCH_RESET_WAIT – Waiting for the completion of the alarm occurrence flag clearing started in the **ALARM_LATCH_RESET** state.

SENSED – Reading the signal, which could change before clearing the alarm occurrence flag in the **ALARM_LATCH_RESET** state. In this state, reading the contents of the file whose name is specified by the **sSensed** string is started.

`SENSED_WAIT` – Waiting for the completion of the reading started in the `SENSED` state.

`ALARM_BYPASS` – State enabling to perform one write or read of another signal between processing of two alarms.

Transitions between states follows the rules in table 3.1. The first column shows the current state, the second column can contain one or more conditions for each current state, and the third column contains the state into which the state-machine goes, if the relevant condition of the second column is fulfilled. Conditions in column two are evaluated from top to bottom for each current state.

3.3 Special signals

In some cases, it is useful/necessary to access the status or configuration variables of the driver. The signals below marked with the **R** (**W**) letter are readable (writeable) signals, i.e. they are inputs (outputs) of the control system.

The driver performs these special signals:

<code>_DGNRESET</code>	W	reset of the accumulated diagnostics information
<code>_TRANSACTIONS</code>	R	total number of transactions with <code>owserver</code>
<code>_RECONNECTS</code>	R	number of reconnections (after communication errors)

All global signals starts with the `_` (underscore) character. In these cases the tripple underscore will be used (e.g. `OWS___DGNRESET`) because of the `__` (double underscore) separator between the diver tag and the signal name.

Moreover, each signal can be suffixed with a special text which determines that a special attribute of the signal will be used instead of the signal value. The special suffixes are the following (all begins with `_`):

<code>_Value</code>	RW	alias for signal value
<code>_DGNRESET</code>	W	reset of the diagnostics information for the given signal
<code>_TRANSACTIONS</code>	R	number of transactions with <code>owserver</code> for the given signal
<code>_ReadEnable</code>	RW	enable to read the signal; equivalent: <code>_RE</code>
<code>_WriteEnable</code>	RW	enable to write the signal; equivalent: <code>_WE</code>
<code>_WriteOneShot</code>	W	one-shot write of the signal; equivalent: <code>_WOS</code>
<code>_Alarm</code>	R	alarm flag of the signal; after reading it is cleared
<code>_PerFactor</code>	R	driver period multiplier for the signal update
<code>_PerCount</code>	R	number of the driver periods from the last signal update
<code>_PerMax</code>	R	maximum number of the driver periods between two consecutive signal updates
<code>_PendCount</code>	R	current number of waiting cycles for returning the value from <code>owserver</code>
<code>_PendLast</code>	R	last number of waiting cycles for returning the value from <code>owserver</code>
<code>_PendMax</code>	R	maximum number of waiting cycles for returning the value from <code>owserver</code>
<code>_Period</code>	R	update period (in seconds) of the signal
<code>_Age</code>	R	the time elapsed since the last update of the signal (signal age)
<code>_AgeMax</code>	R	maximum signal age from the last reset of the diagnostics information

#	State	Transition Conditions	New State
-1	NOT_USED	At least one configured alarm found	INIT
0	INIT	Start of reading the /alarm directory	ALARM_DIR
1	ALARM_DIR	Reading of the /alarm directory completed	ALARM_PROCESS
2	ALARM_PROCESS	If nMaxConsAlarms is consecutively read then	ALARM_BYPASS
		else	ALARM_POR_READ
		At the end of alarm cycle assign: iAlarmPos = -1. Then	ALARM_BYPASS
3	ALARM_POR_READ	If sAlarmPor is not defined then next alarm	ALARM_PROCESS
		If sAlarmPor is empty then	ALARM_LATCH
		After succesful read of sAlarmPor	ALARM_POR_READ_WAIT
4	ALARM_POR_READ_WAIT	If the variable por is not equal to zero	ALARM_SET
		If por is equal to zero	ALARM_LATCH
5	ALARM_SET	If sSet or sSetVal is not defined then next alarm	ALARM_PROCESS
		If sSet or sSetVal is empty then	ALARM_POR_RESET
		Assign iAlarmInitPos = -1; After successful write	ALARM_SET_WAIT
6	ALARM_SET_WAIT	Iterate iAlarmInitPos. For found write commands	ALARM_INIT_WRITE_WAIT
		At the end of the cycle: iAlarmInitPos = -1; then	ALARM_POR_RESET
7	ALARM_INIT_WRITE_WAIT	If iAlarmInitPos < 0 then	ALARM_POR_RESET
		else	ALARM_SET_WAIT
8	ALARM_POR_RESET	If sAlarmPor is not defined then next alarm	ALARM_PROCESS
		If sAlarmPor is empty then	ALARM_LATCH
		After successful write	ALARM_POR_RESET_WAIT
9	ALARM_POR_RESET_WAIT	After completion the request	ALARM_LATCH
10	ALARM_LATCH	If sLatch is not defined or is empty then next alarm	ALARM_PROCESS
		After successful reading	ALARM_LATCH_WAIT
11	ALARM_LATCH_WAIT	If the variable latch is not equal to zero then	ALARM_SENSED
		else next alarm	ALARM_PROCESS
12	ALARM_SENSED	If sSensed is not defined then next alarm	ALARM_PROCESS
		If sSensed is empty then	ALARM_LATCH_RESET
		After successful reading	ALARM_SENSED_WAIT
13	ALARM_SENSED_WAIT	After completion the request	ALARM_LATCH_RESET
14	ALARM_LATCH_RESET	If sLatchRes or sLatchResVal is not defined then	ALARM_PROCESS
		If sLatchRes or sLatchResVal is empty then	SENSED
		After successful write	ALARM_LATCH_RESET_WAIT
15	ALARM_LATCH_RESET_WAIT	After completion the request	SENSED
16	SENSED	If sSensed is not defined or is empty then next alarm	ALARM_PROCESS
		After successful reading	SENSED_WAIT
17	SENSED_WAIT	After completion the request	ALARM_PROCESS
18	ALARM_BYPASS	If iAlarmPos >= 0 then next alarm	ALARM_PROCESS
		Else continue from the beginning	INIT

Table 3.1: Alarm processing state-machine

Chapter 4

Troubleshooting

In the case that the diagnostic tools of the REXYGEN system (e.g. `Watch` mode in the REXYGEN Studio) report unexpected or incorrect values of inputs or outputs, it is desirable to test the functionality outside the REXYGEN system (command line tools, simple Python script, etc.). Also double check the configuration – the most common problems include:

Hardware problem – incorrect wiring

Kernel modules for I2C or USB devices are not loaded

Incorrect device ID

Too long period of a task reading signals from `OwsDrv` (the system log contains regularly the `Socket Error`). It is necessary to increase the `owserver` timeout by the command line parameter `--timeout_server=60` (timeout increased to 60 seconds)

In the case that the given input or output works with other software tools and does not work in the REXYGEN system, report the problem to us, please. E-mail is preferred, reach us at support@rexygen.com. Please include the following information in your description to help us process your request as soon as possible:

- Identification of the REXYGEN system you are using. Simply export it to a file using the REXYGEN Studio program (Target → Licensing → Export).
- Short and accurate description of your problem.
- The configuration files of the REXYGEN system (`.mdl` files) reduced to the simplest case which still demonstrates the problematic behavior.

Bibliography

- [1] Maxim Integrated. 1-Wire Application Notes. <http://www.maximintegrated.com>, 2013.
- [2] Paul Alfille. OWFS 1-Wire Filesystem. <http://www.owfs.org>, 2013.
- [3] REX Controls s.r.o.. *Getting started with REXYGEN on Debian*, 2020. [→](#).